


NOTE:

1. CONNECTION TO MAIN LINE AND FIRST AUXILIARY VALVE SHALL BE FLANGED.
2. FOR HYDRANT LATERAL LENGTHS OVER 6 L.F. INSTALL AN ADDITIONAL 6" FLG X MJ GATE VALVE AT THE HYDRANT
3. PIPE BEDDING SHALL COMPLY WITH SANDY CITY STANDARDS SPECIFICATIONS
4. ALL BOLTS, NUTS, AND T-BOLTS SHALL BE LUBRICATED WITH FML GREASE.

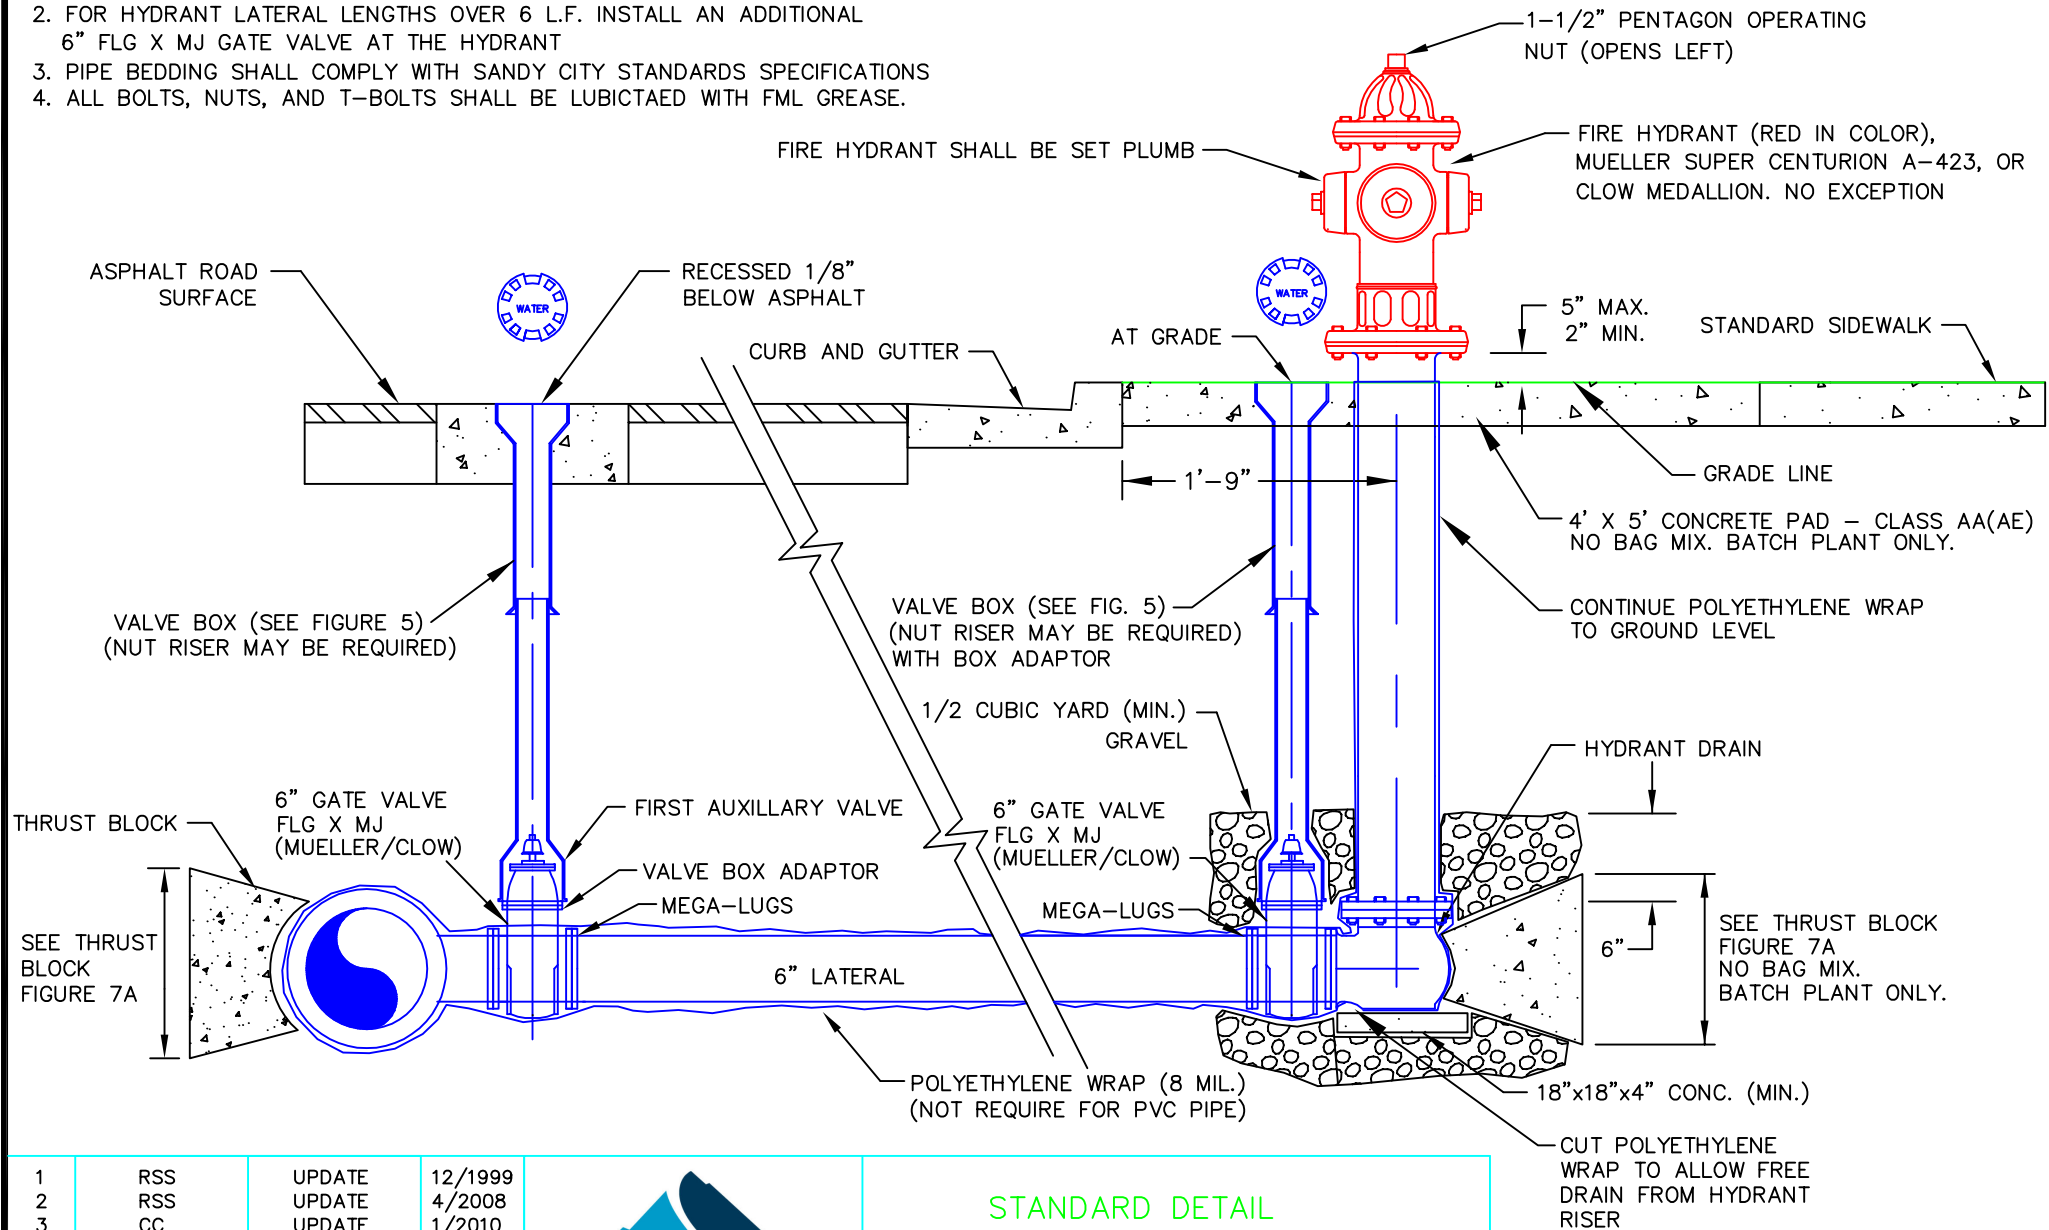

STANDARD DETAIL
FIGURE 02
FIRE HYDRANT CONNECTION

SCALE: NONE

1	RSS	UPDATE	12/1999
2	RSS	UPDATE	4/2008
3	CC	UPDATE	1/2010
4	CC	UPDATE	5/2013
5	CC	UPDATE	3/2015
NO.	AUTHORIZED BY	REVISIONS	DATE

